



5

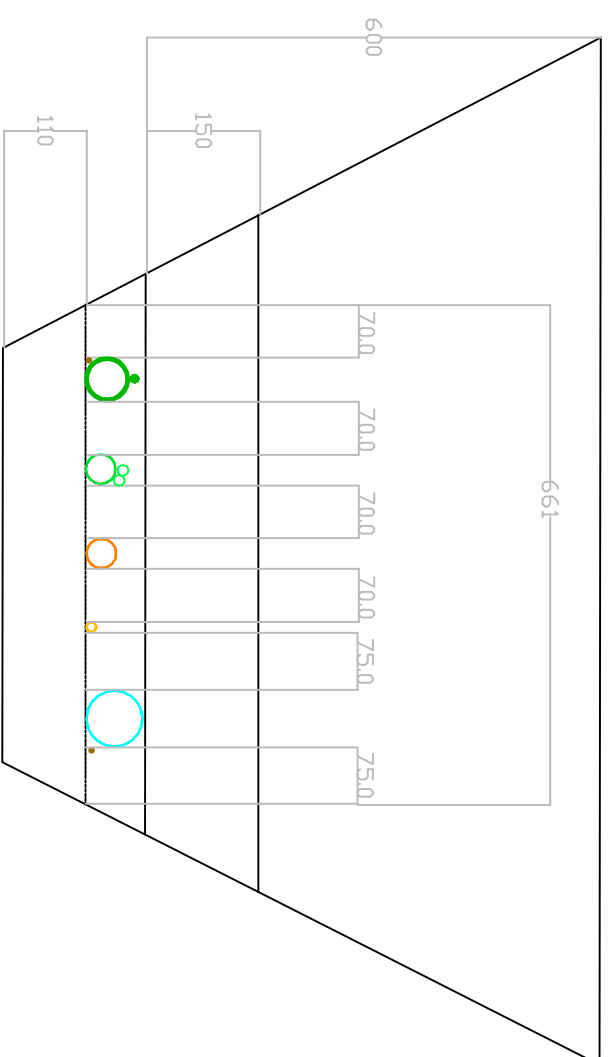


TKN 1x4x240mm2 TFXP-D AL
Canal Digital 1xØ40mm PE
Canal Digital 2xØ14mm PE
Broodnet 1xØ40mm PE
Broodnet 1xØ12mm PE
Tromsø kommune 1xØ75mm PVC SN8
Tromsø kommune Jording KGF Cu25mm2

Split 14

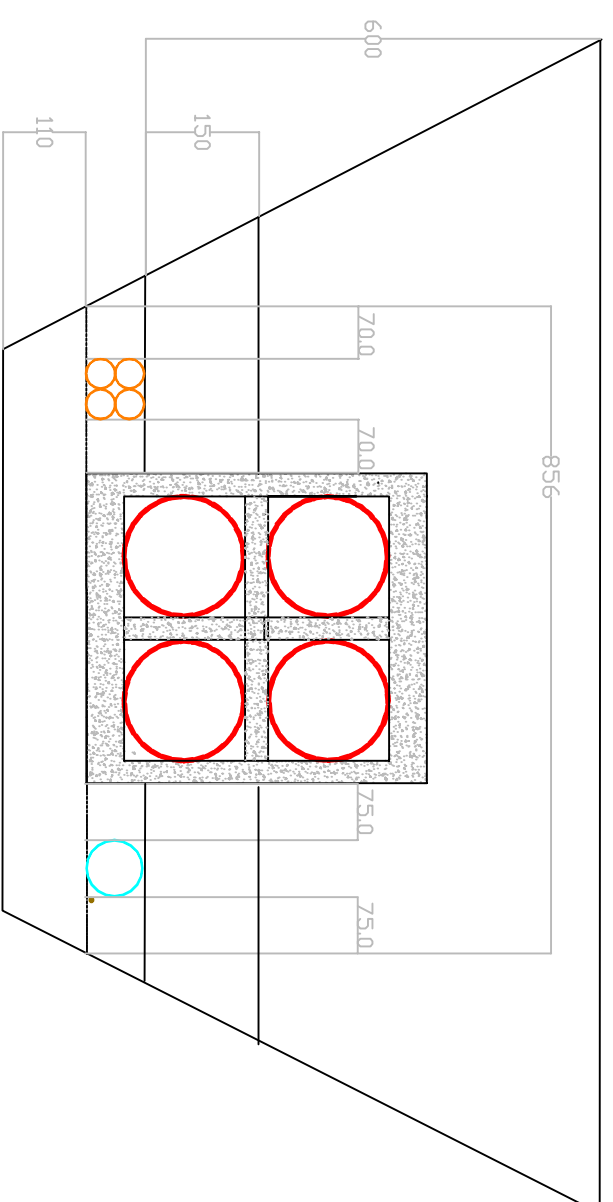


DPI 4x0160-rør
Broadnet 4x040mm PE
Tromsø kommune 1x075mm PVC SN8
Tromsø kommune Jordling KGF Cu25mm2

Skitt 17

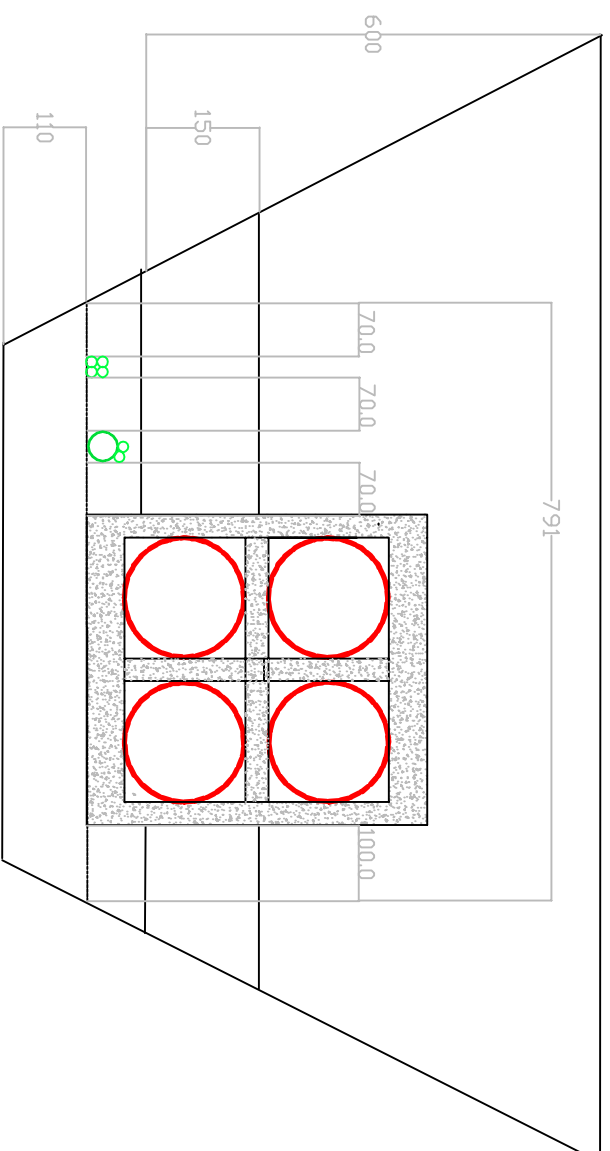


DPI 4x0160-rør
Canal Digital 1x040mm PE
Canal Digital 6x014mm PE
Tromsø kommune 1x075mm PVC SN8
Tromsø kommune Jordving KGF Cu25mm2

Split 10

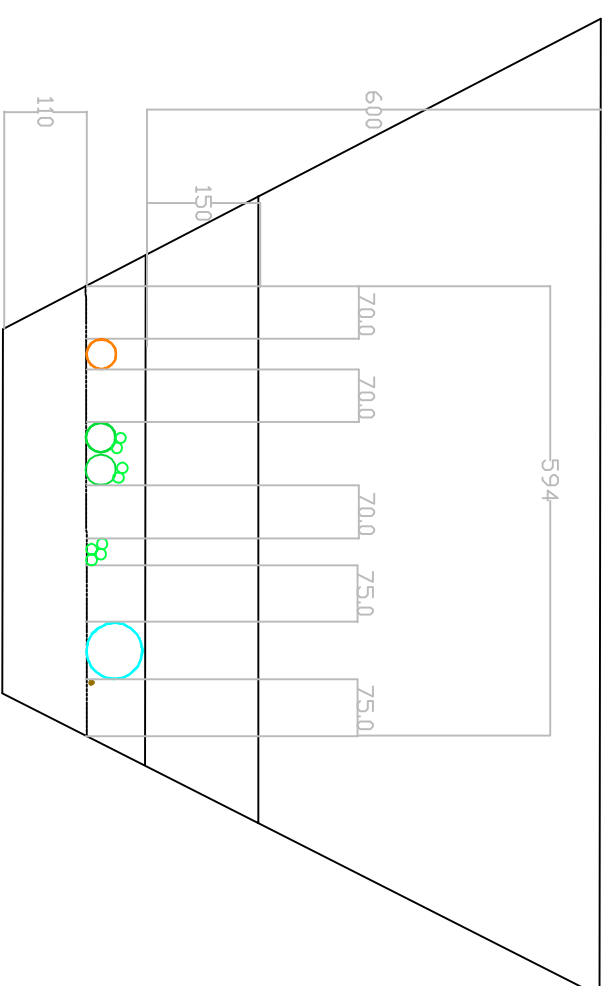


Broodnet 1xØ40mm PE
Canal Digital 2xØ40mm PE
Canal Digital 8xØ14mm PE
Tromsø komune 1xØ75mm PVC SN8
Tromsø komune Jording KGF Cu25mm2

Split 15

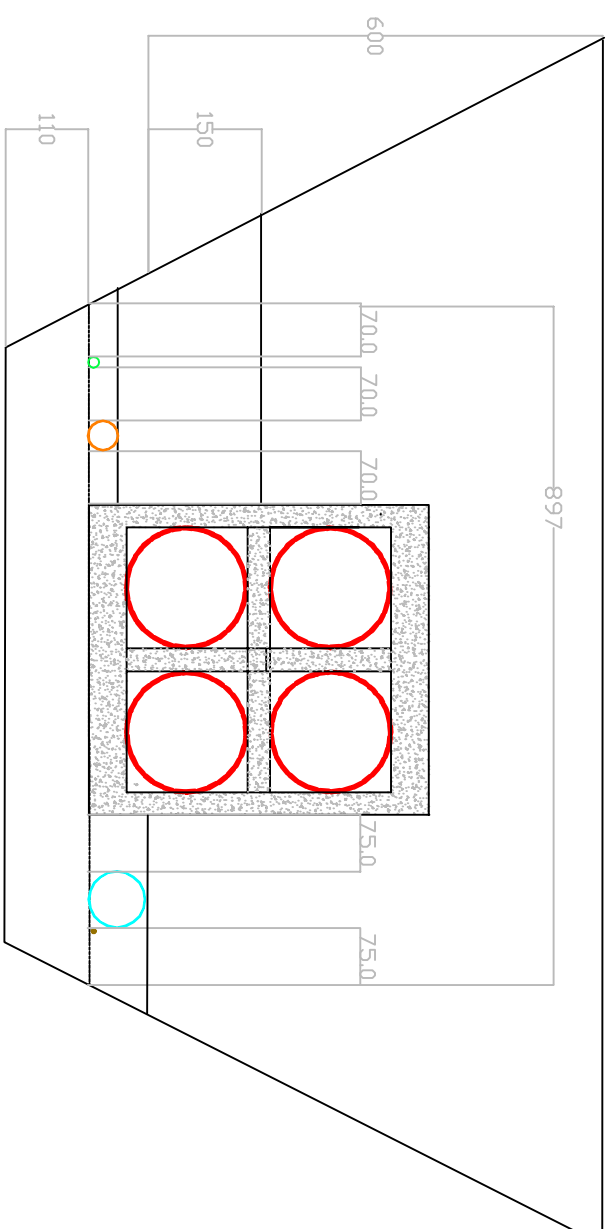


DPI 4x0160-rør
Canal Digital 1x014mm PE
Broodnet 1x040mm PE
Tromsø kommune 1x075mm PVC SN8
Tromsø kommune Jording KGF Cu25mm2

Smith 18

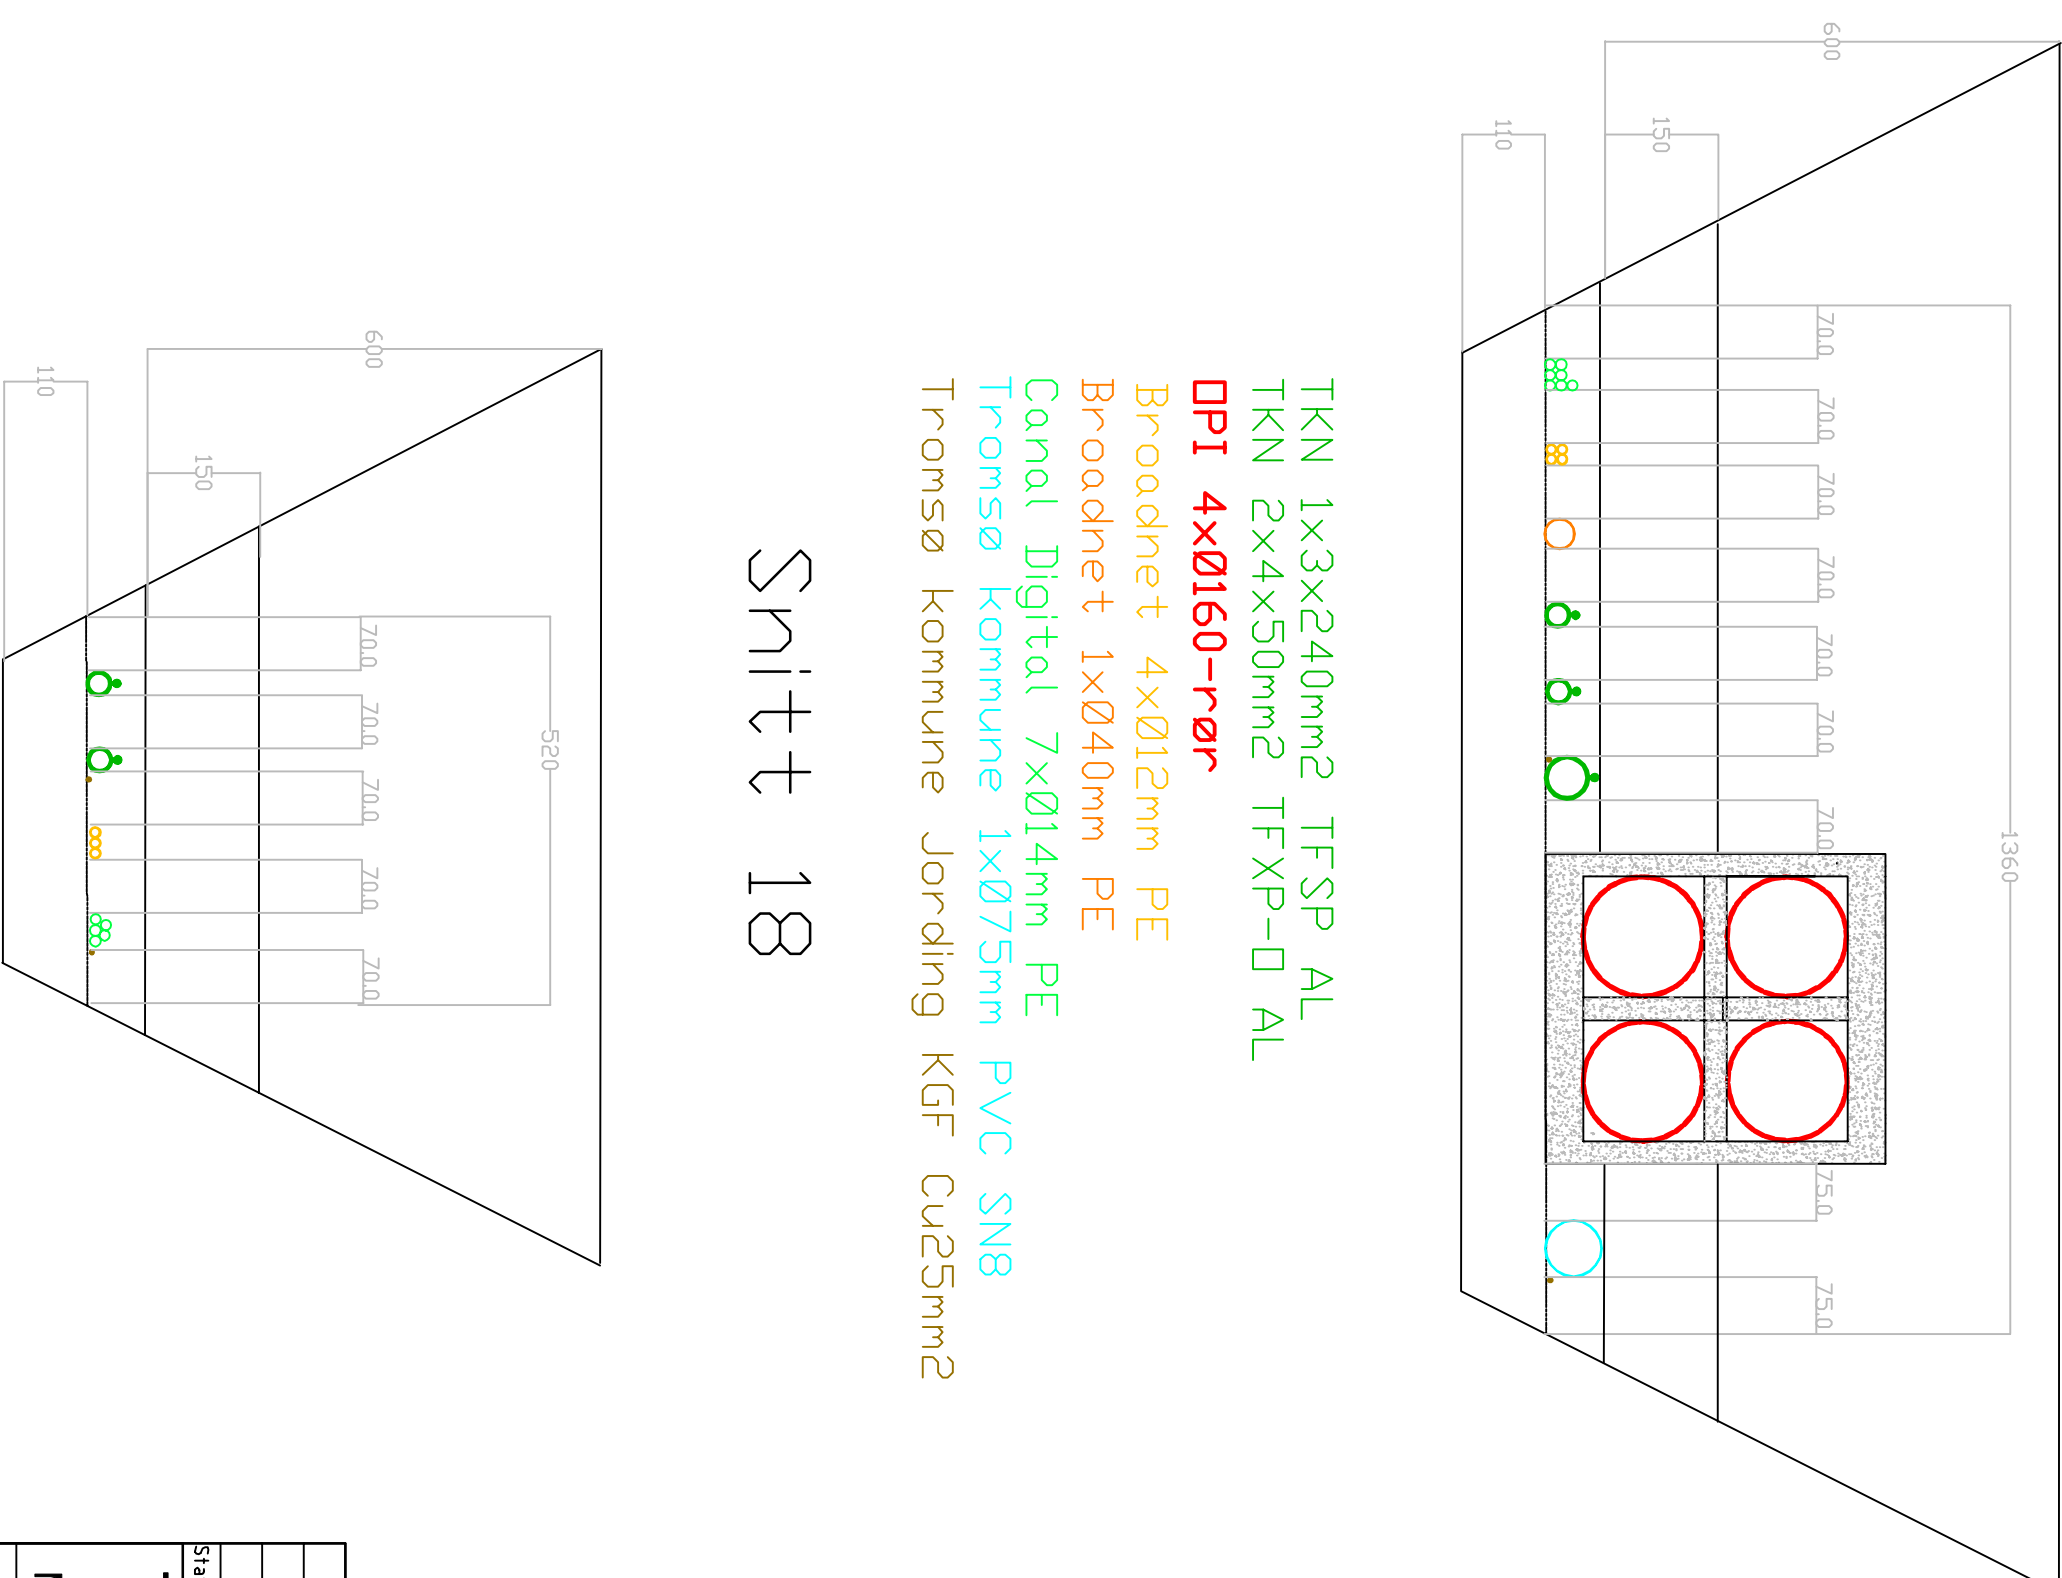


TKN 1x3x240mm2 TFSP AL
TKN 2x4x50mm2 TFXP-0 AL
~~DPI 4x0160-rør~~
Broodnet 4x012mm PE
Broodnet 1x0440mm PE
Canal Digital 7x014mm PE
Trasmø kommune 1x075mm PVC SN8
Trasmø kommune Jording KGF Cu25mm2

Split 12

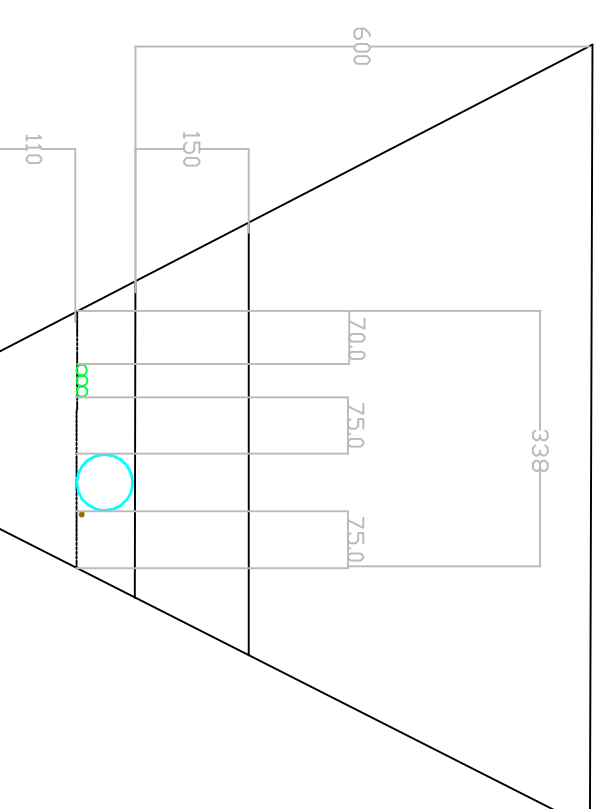

Canal Digital 3xØ14mm PE
Tromsø kommune 1xØ75mm PVC SN8
Tromsø kommune Jording KGF Cu25mm²

Shift 13

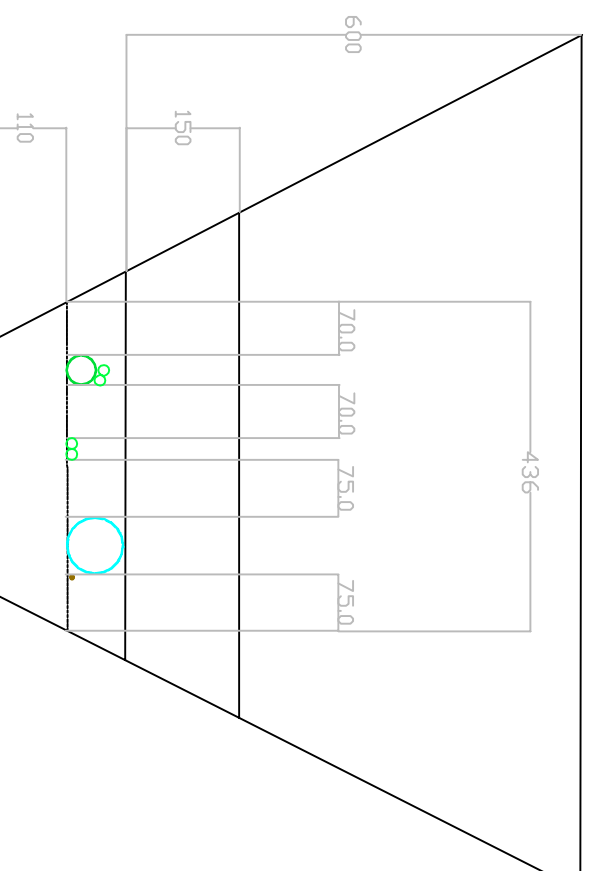

Canal Digital	1xØ40mm	PE
Canal Digital	4xØ14mm	PE
Tromsø kommune	1xØ75mm	PVC SN8
Tromsø kommune	Jording	KGF Cu25mm2

[illegible]